


# Rückschlagklappe/Swing Check Valve

## Masszeichnung/Dimensional drawing

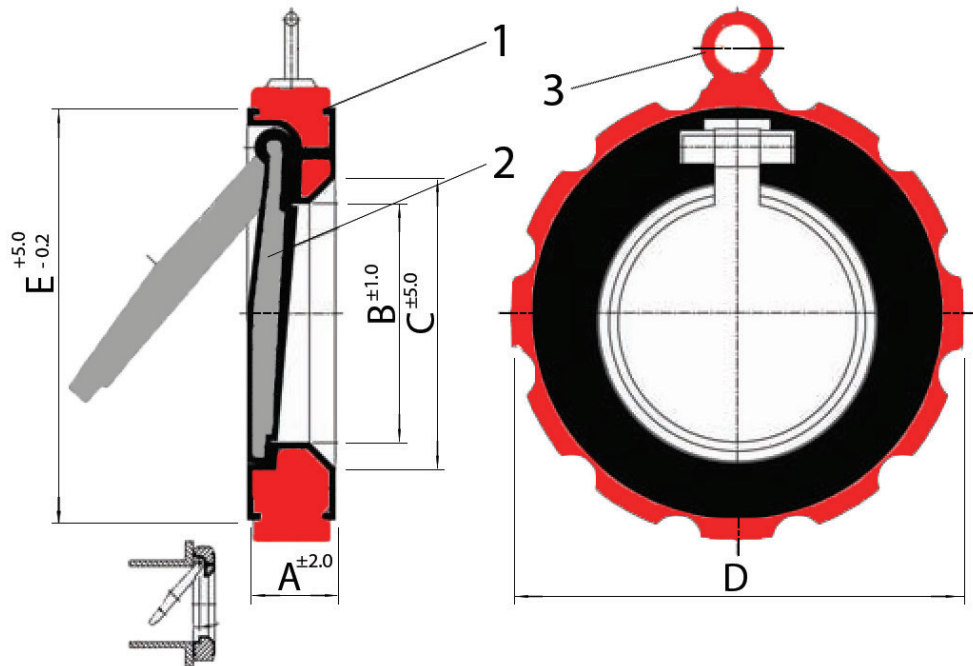

| GRÖSSE<br>SIZE | A*2<br>[mm] | B<br>[mm] | C<br>[mm] | D<br>[mm] | E<br>[mm] | Inner Pipe ø |     | Max.<br>Opening |
|----------------|-------------|-----------|-----------|-----------|-----------|--------------|-----|-----------------|
| DN 40 - 1 1/2" | 33          | 20        | 35        | 95        | 70        | 35           | 46  | 52°             |
| DN 50 - 2"     | 43          | 30        | 52        | 110       | 90        | 46           | 56  | 52°             |
| DN 80 - 3"     | 46          | 42        | 64        | 142       | 124       | 73           | 82  | 52°             |
| DN 100 - 4"    | 52          | 65        | 80        | 180       | 152       | 95           | 100 | 60°             |
| DN 150 - 6"    | 56          | 111       | 128       | 233       | 207       | 145          | 150 | 60°             |
| DN 200 - 8"    | 60          | 133       | 175       | 295       | 260       | 192          | 195 | 60°             |
| DN 250 - 10"   | 68          | 184       | 224       | 348       | 317       | 242          | 260 | 52°             |
| DN 300 - 12"   | 78          | 232       | 272       | 398       | 367       | 292          | 310 | 52°             |
| DN 350 - 14"   | 92          | 252       | 297       | 426       | 397       | 315          | 330 | 48°             |
| DN 400 - 16"   | 102         | 327       | 370       | 510       | 470       | 380          | 390 | 45°             |

\*2 Gemäss DIN EN558-1, Row 20  
Test gemäss DIN EN 12266-1

\*2 As per DIN EN558-2, Row 20  
Testing in accordance with DIN EN 12266-1